

Ratings and Impedances



Chuck DuBose

Cell: +1-804-683-3479

E-Mail: chuck.dubose@pcitek.com

Topics

- ▶ Ratings overview
- ▶ Transformer Model
- ▶ Line Model
- ▶ Asset, AssetInfo
- ▶ Component Ratings
 - ▶ Switching Equipment
 - ▶ Wire, Risers
 - ▶ Relay Equipment
- ▶ Operational Limits
- ▶ Mutual Impedance


Overview



Asset Information



Transformer Test Report

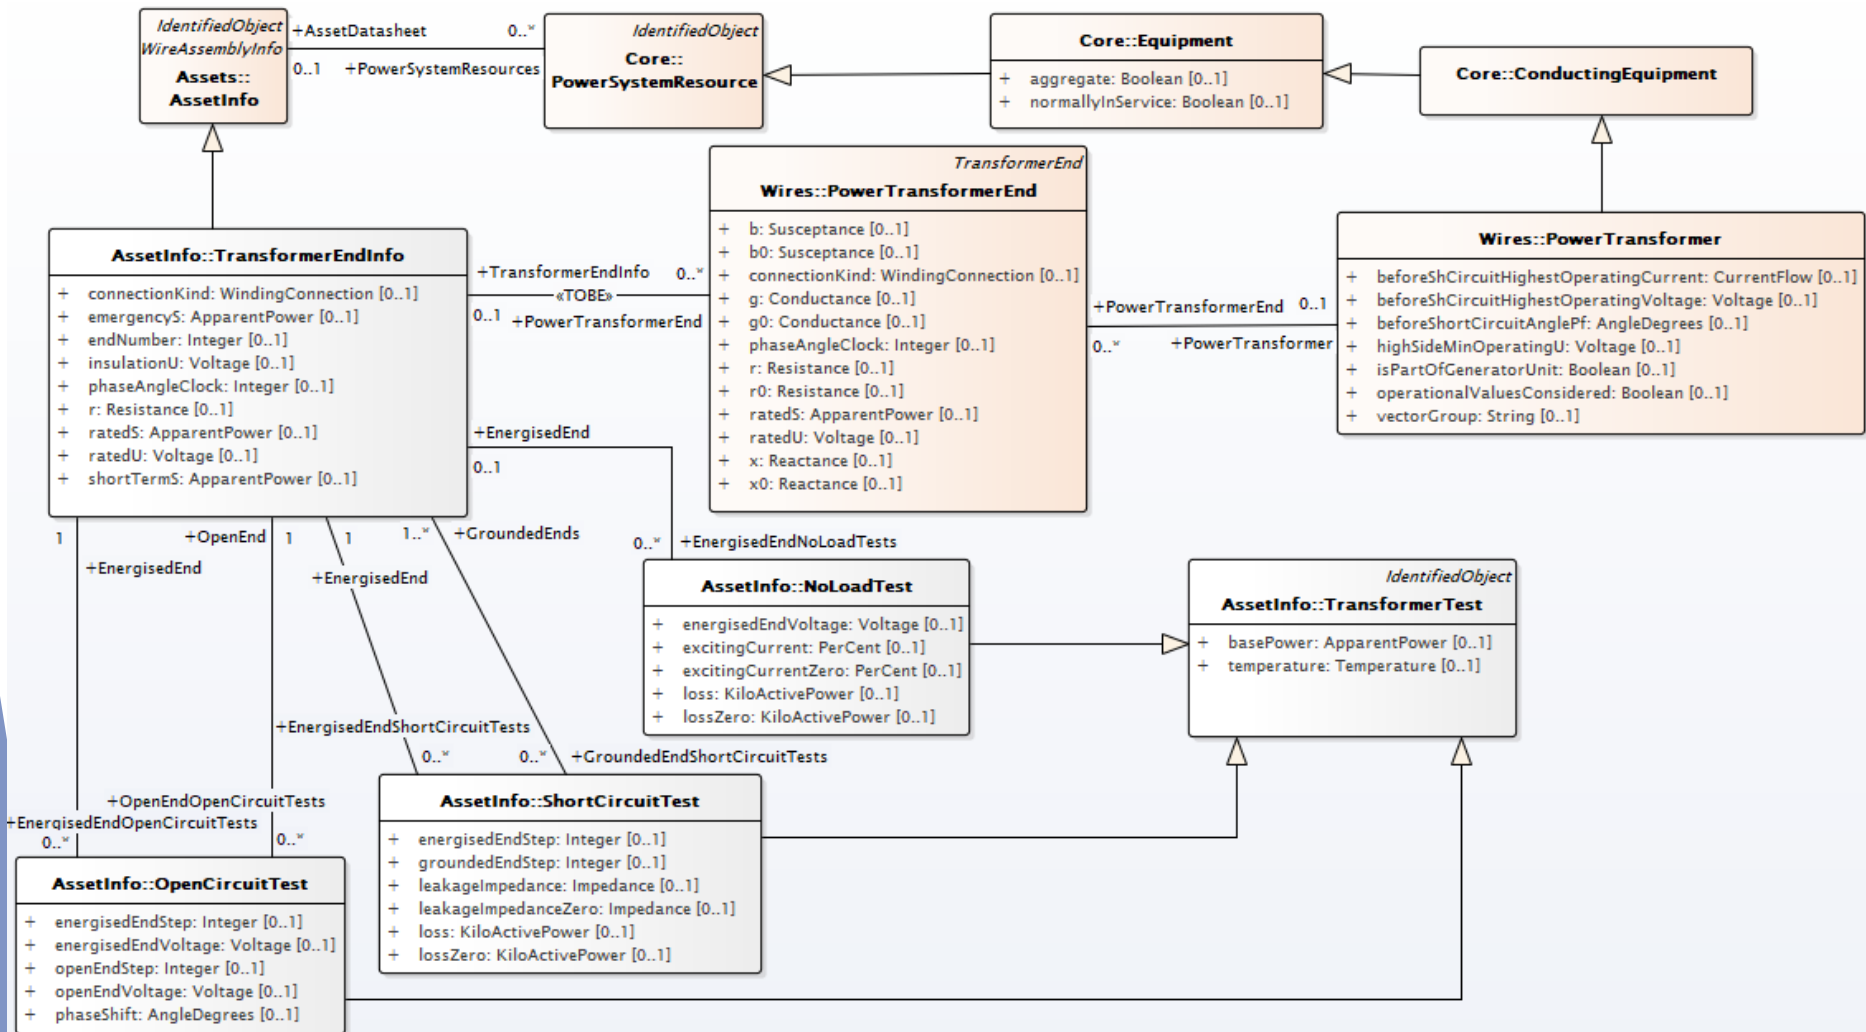

ACLineSeriesSection

ACLineSegment


Sub

Sub

ACLineSeriesSection

ACLineSeriesSection

ACLineSeriesSection

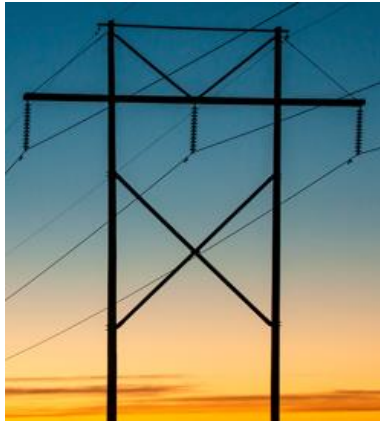

795 Drake ACSR
#2 Sparrow ACSR




927.2 Greeley AAAC
#1 Robin ACSR




1272 Bittern ACSR
1/0 Raven ACSR


Line Model 61970

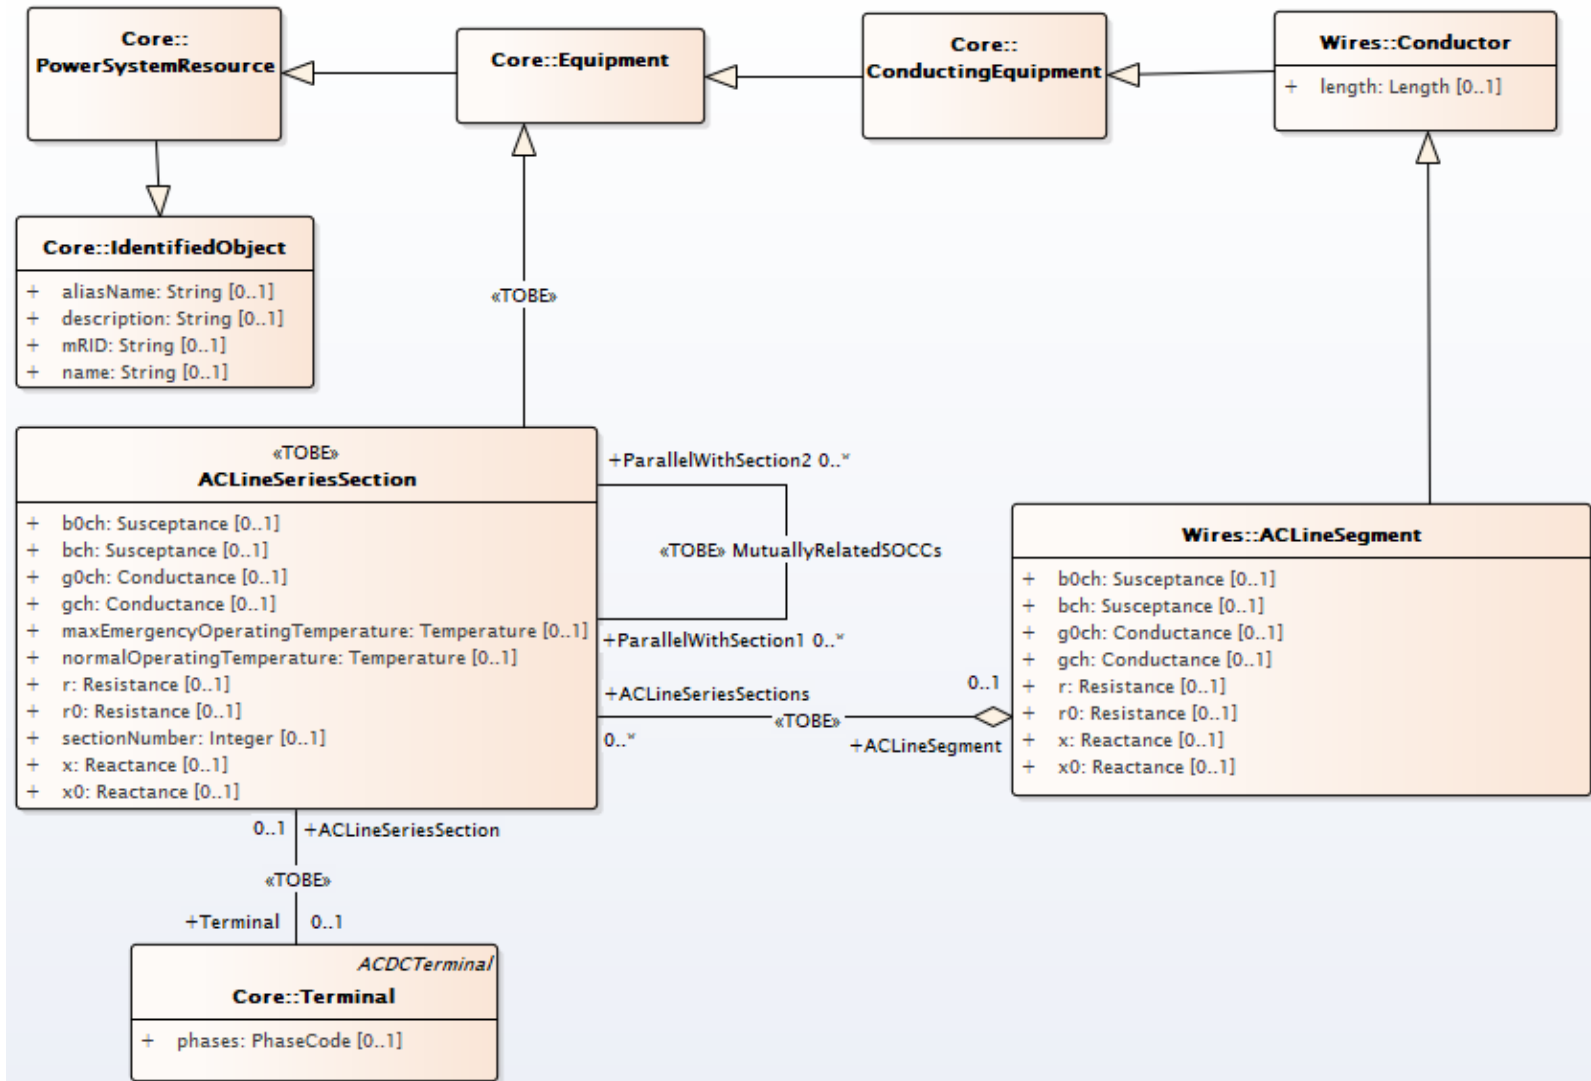


Maximum Operating Temperature

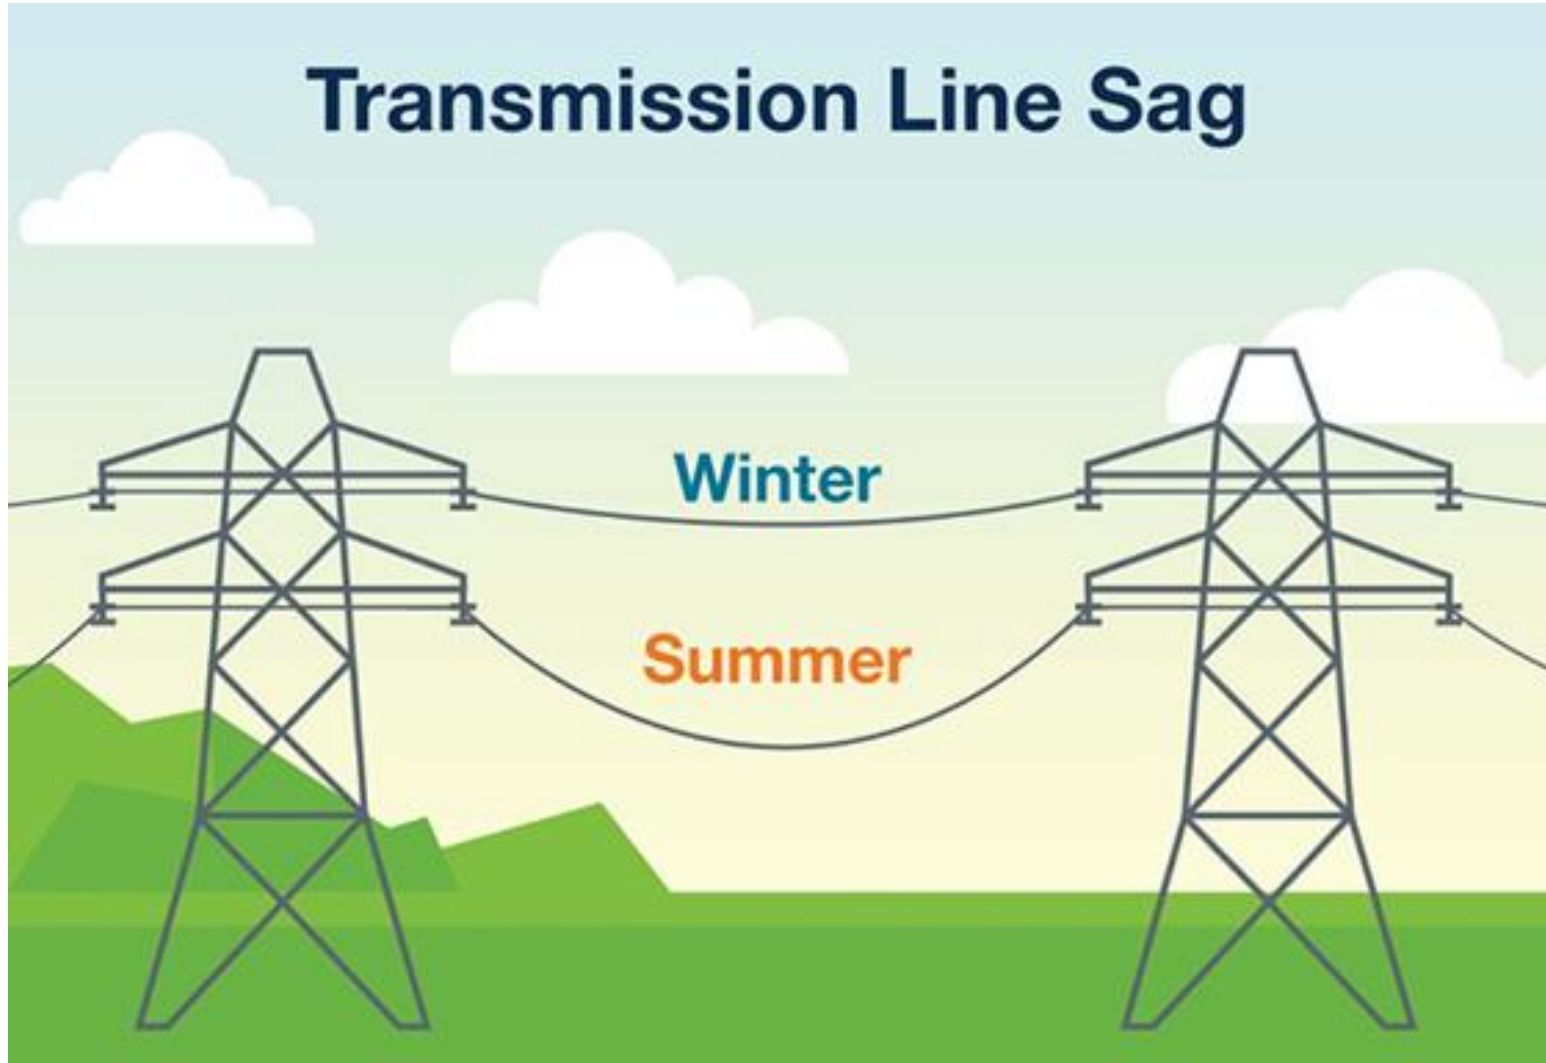


Asset Info Model

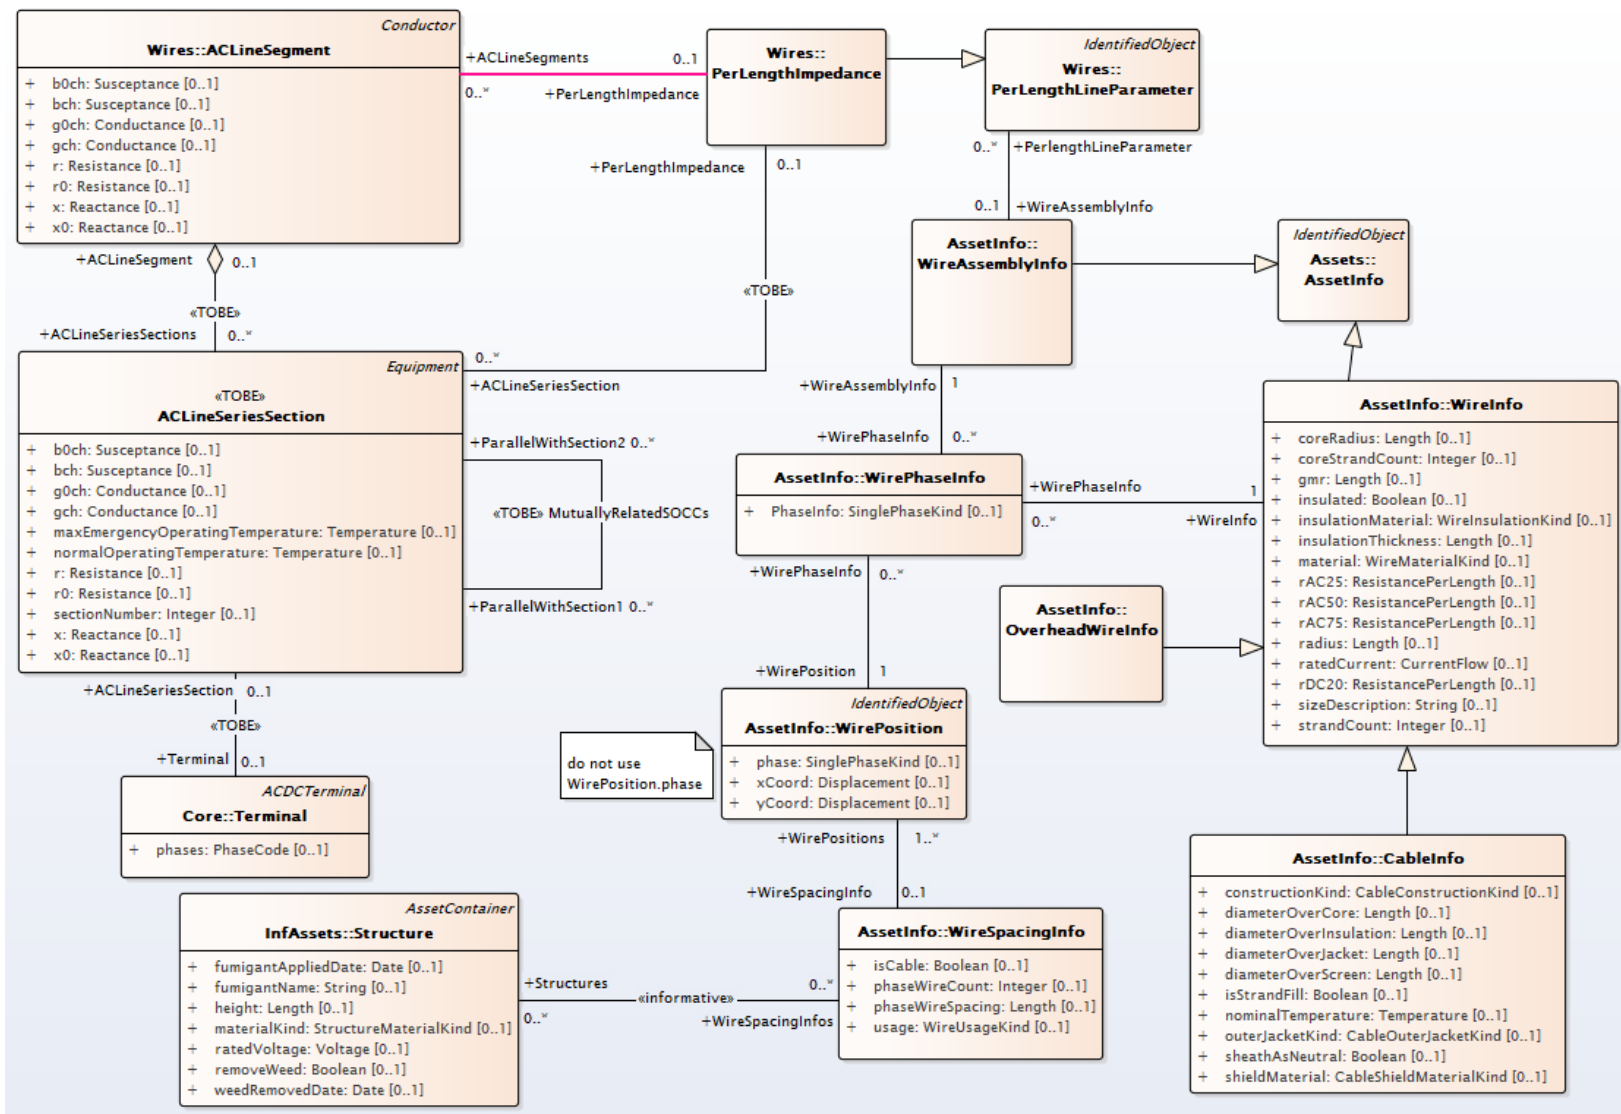


Relays

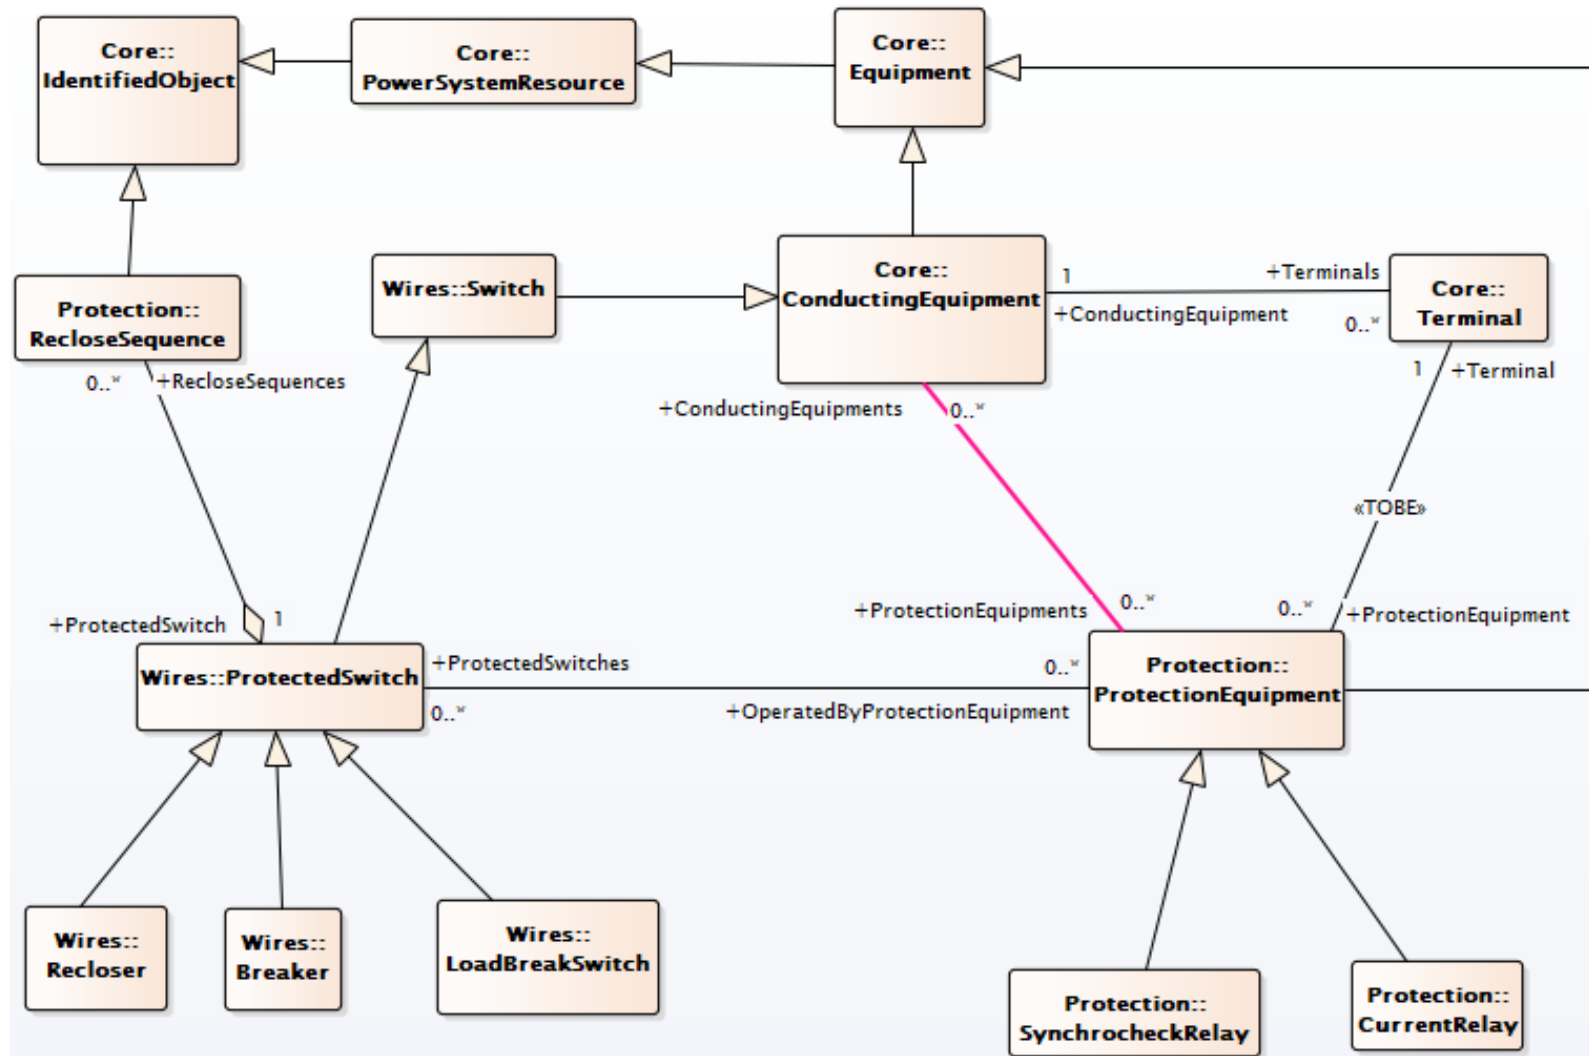


Auxiliary Equipment

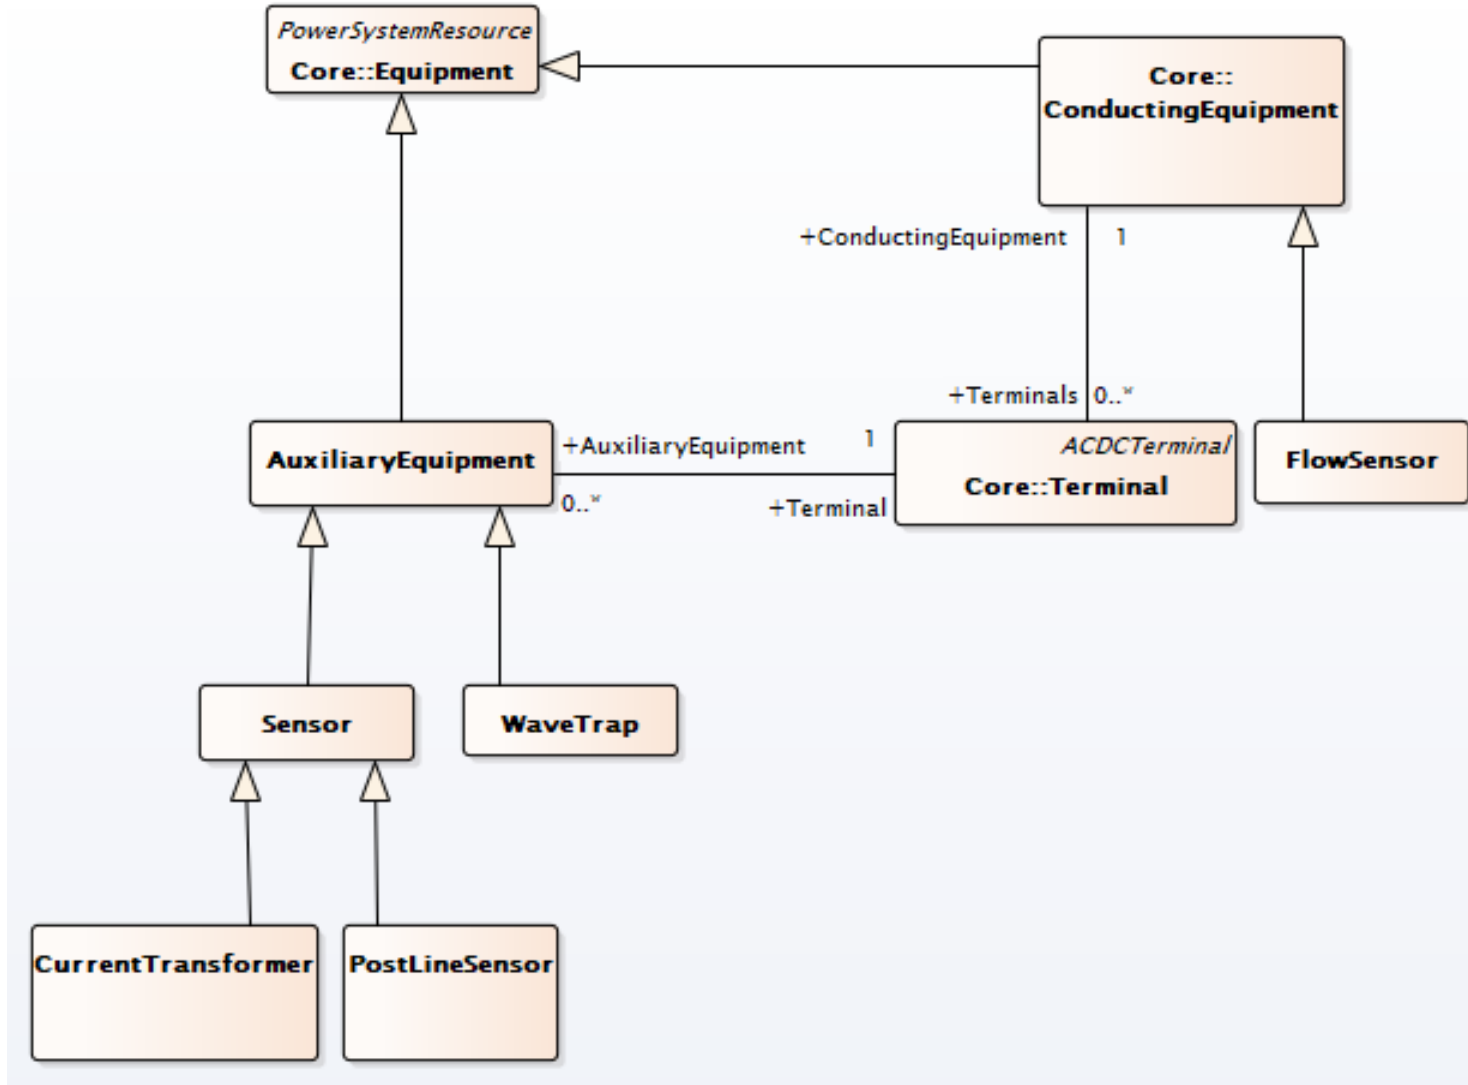

Circuit

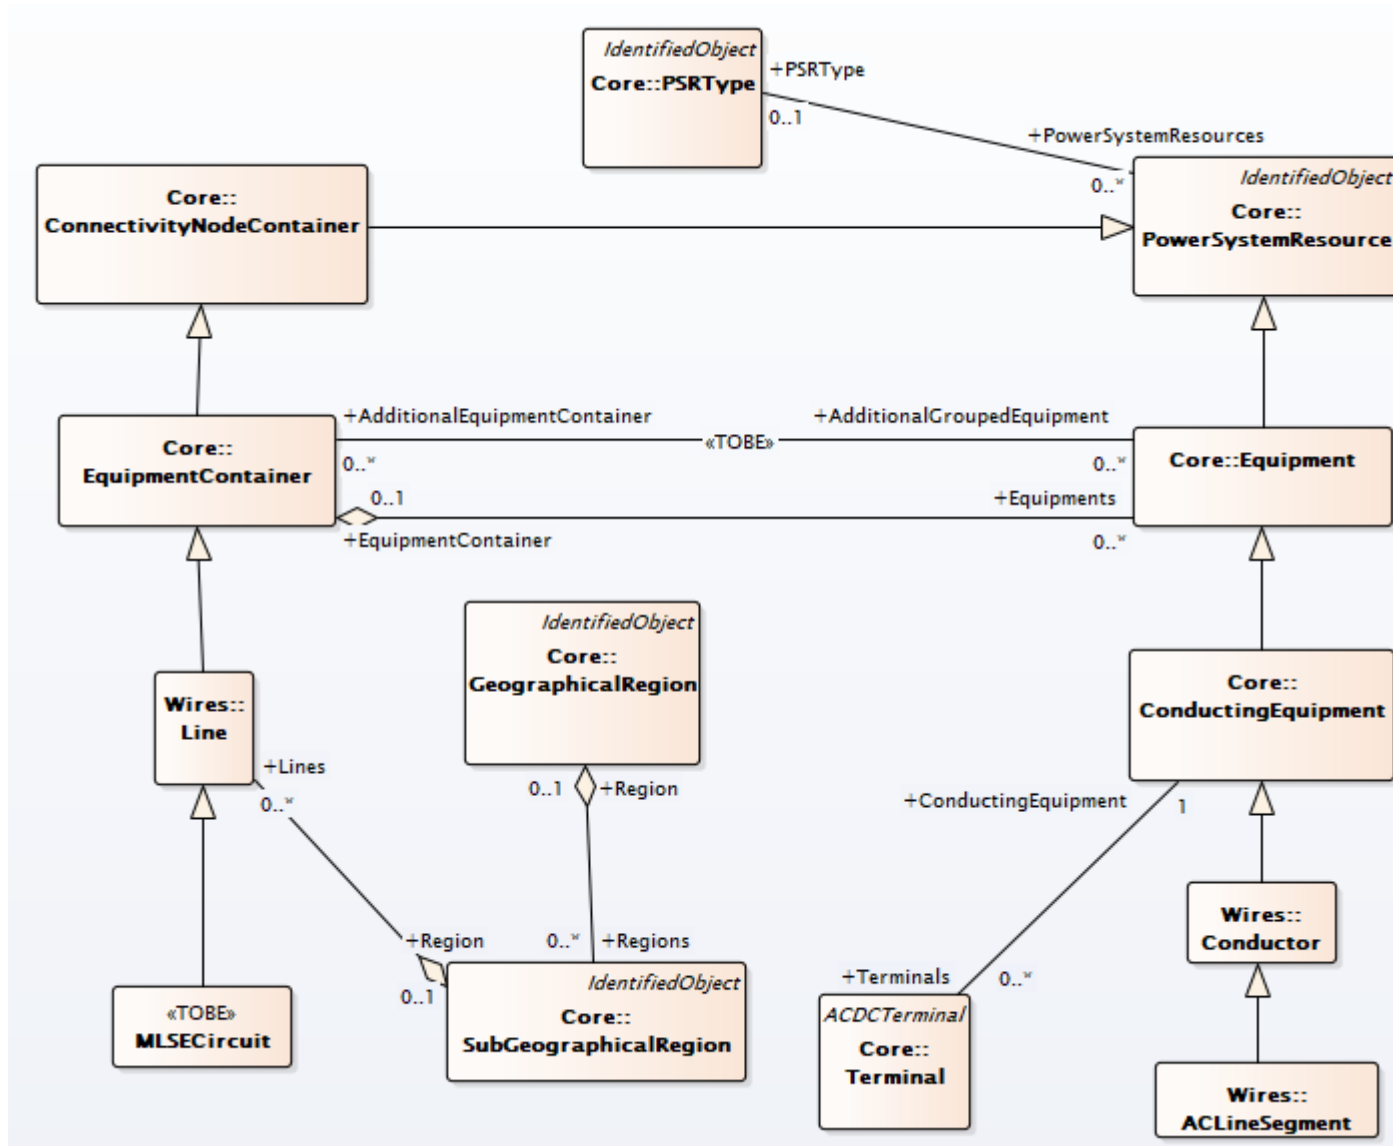


OperationalLimits

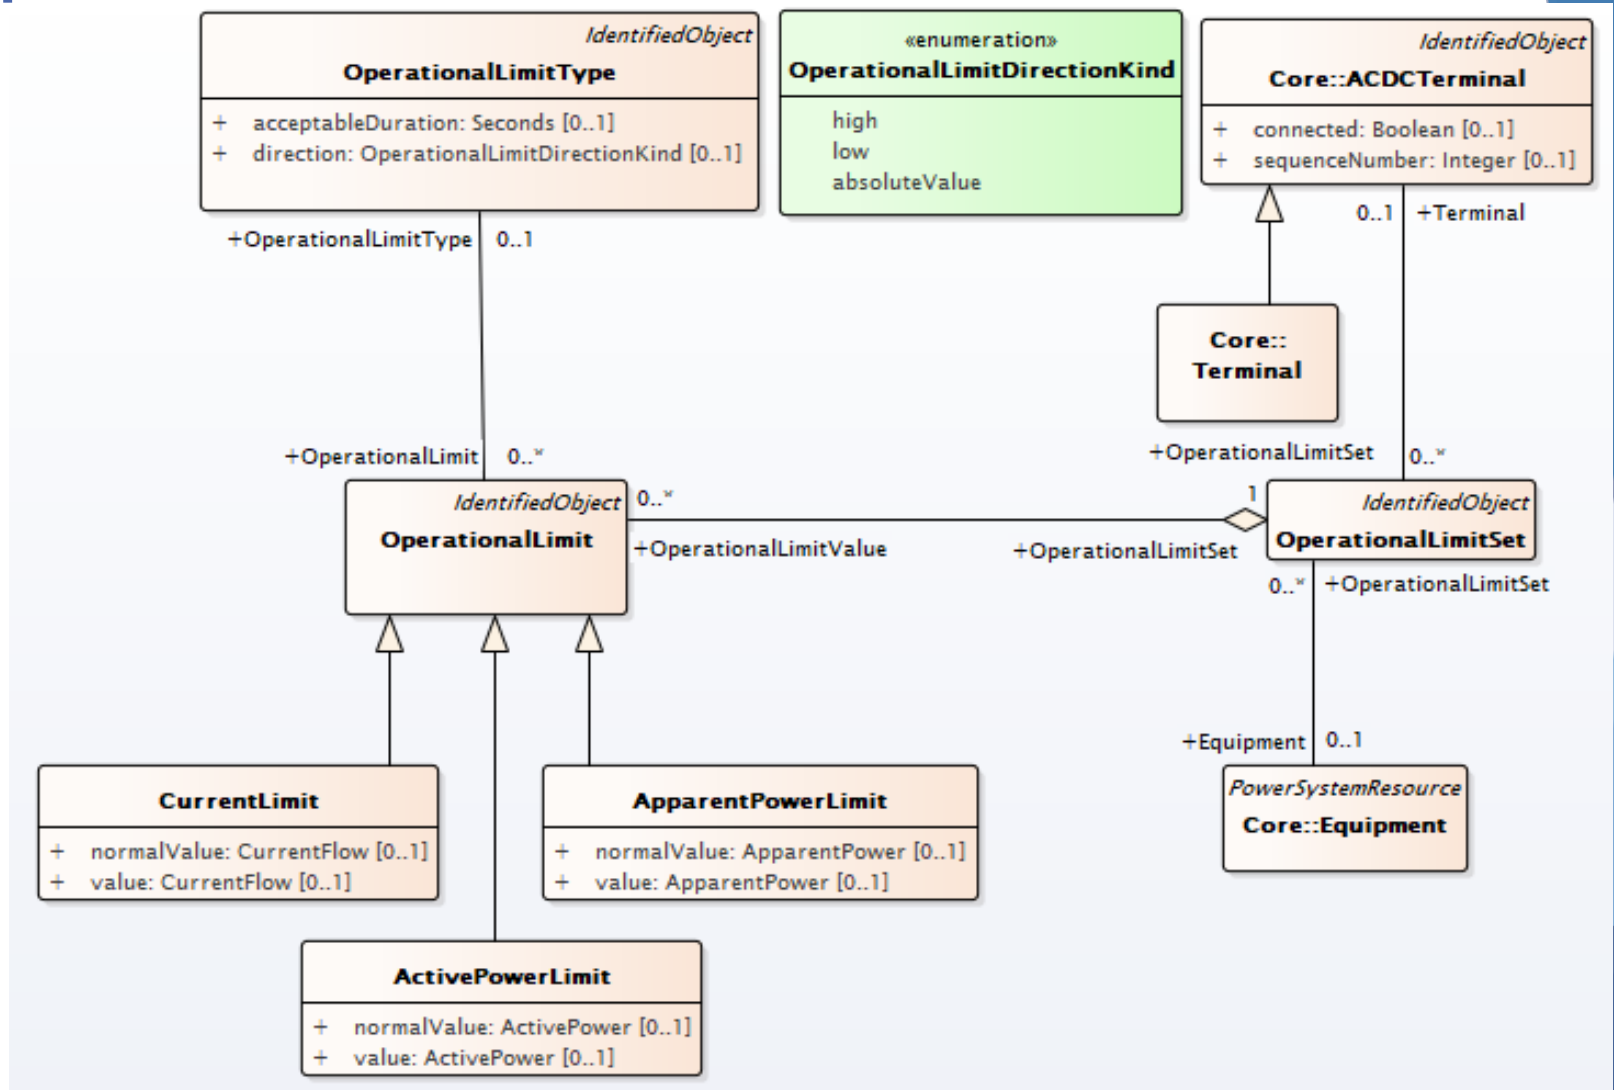


Mutual Impedance



Parallel Line Diagram

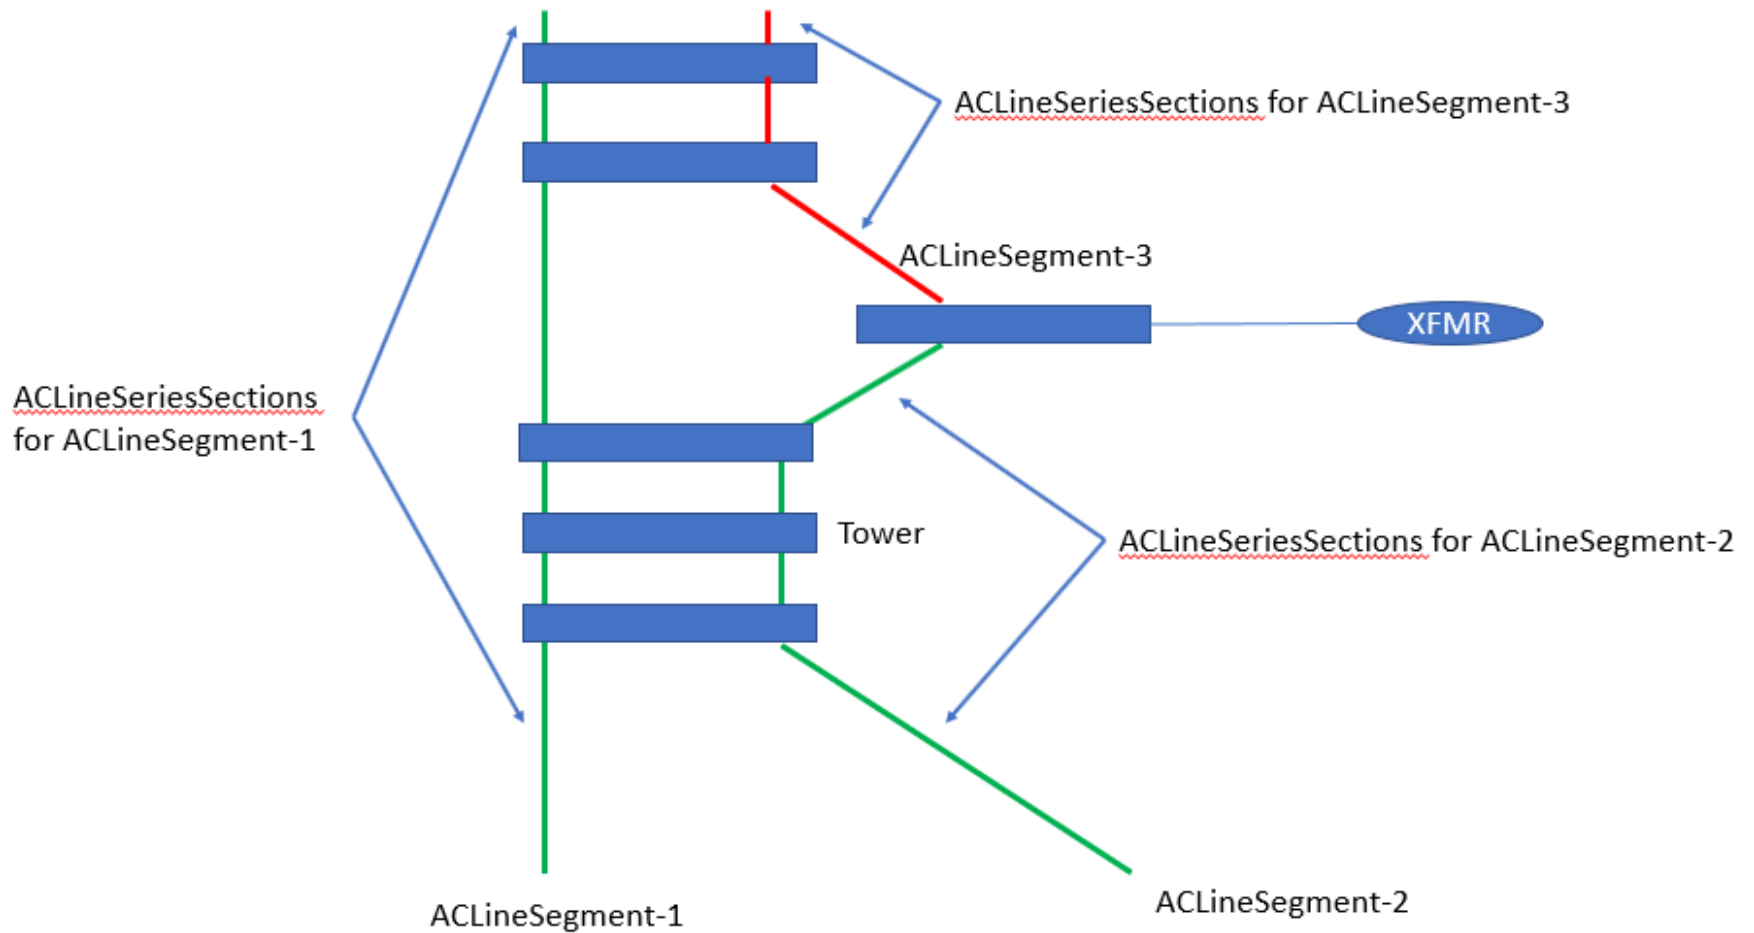

Mutual Coupling

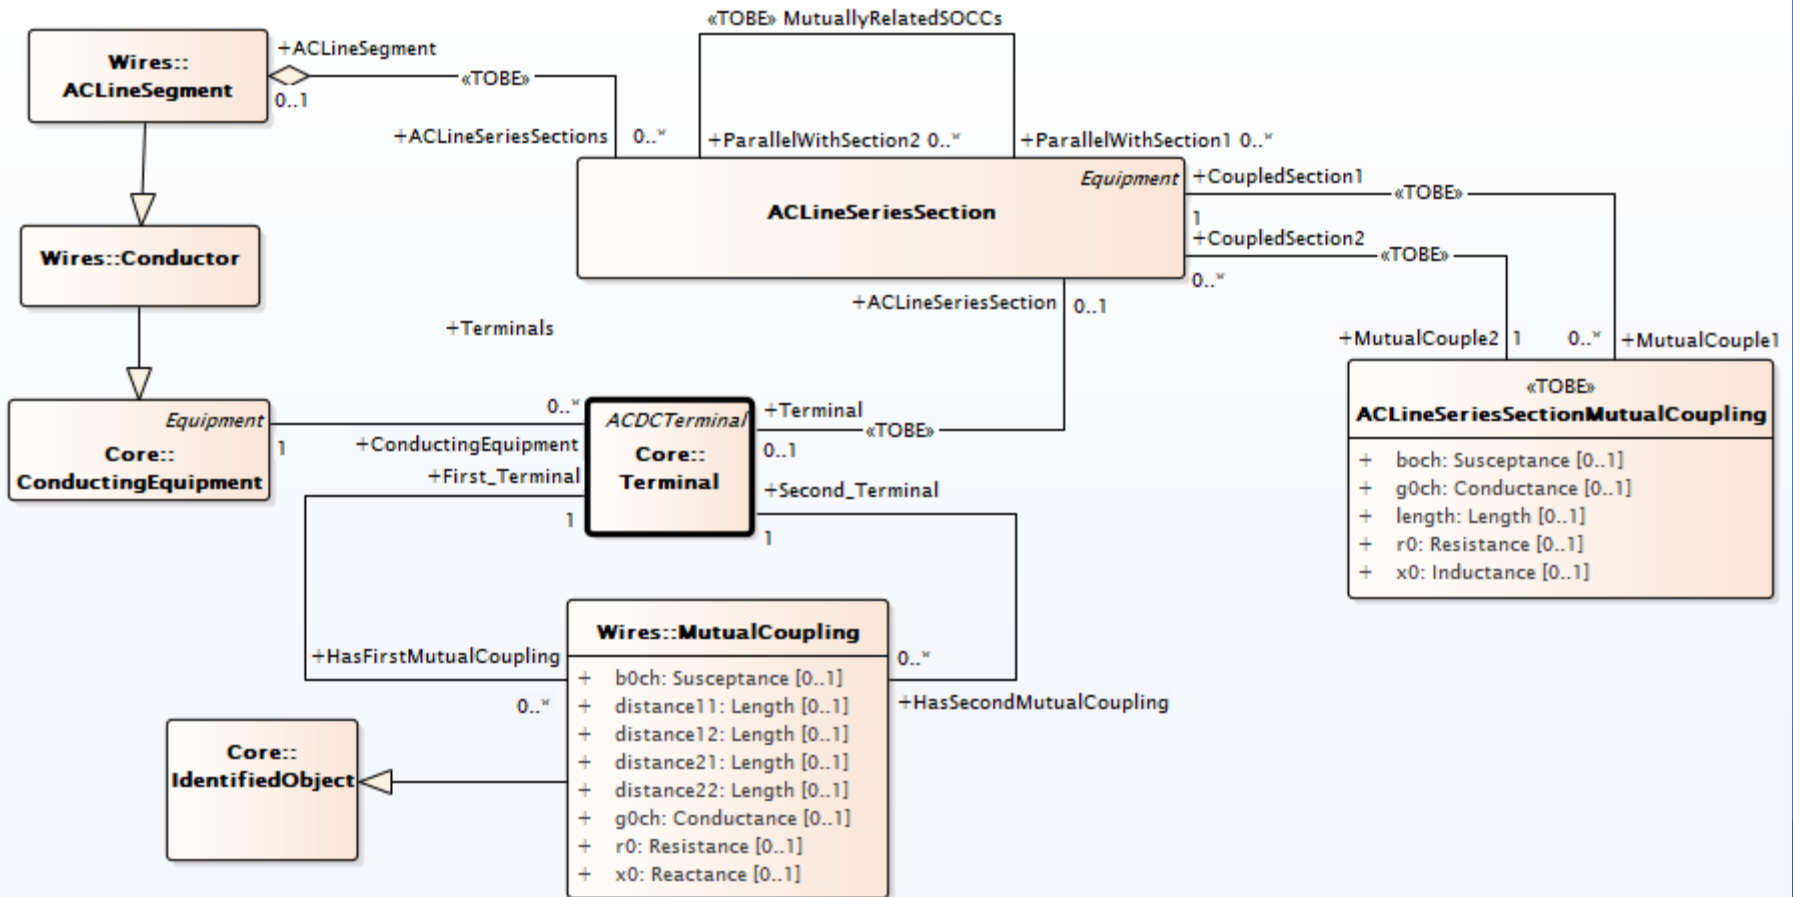

Thanks!



Chuck DuBose
PCIttek, LLC
chuck.dubose@pcitek.com
804-683-3479